

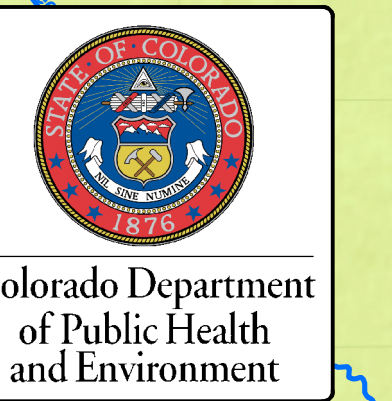


Drinking Water & Wastewater System Facilities September 12th - 27th 2013 Flooded Area Water Quality Control Division - CDPHE

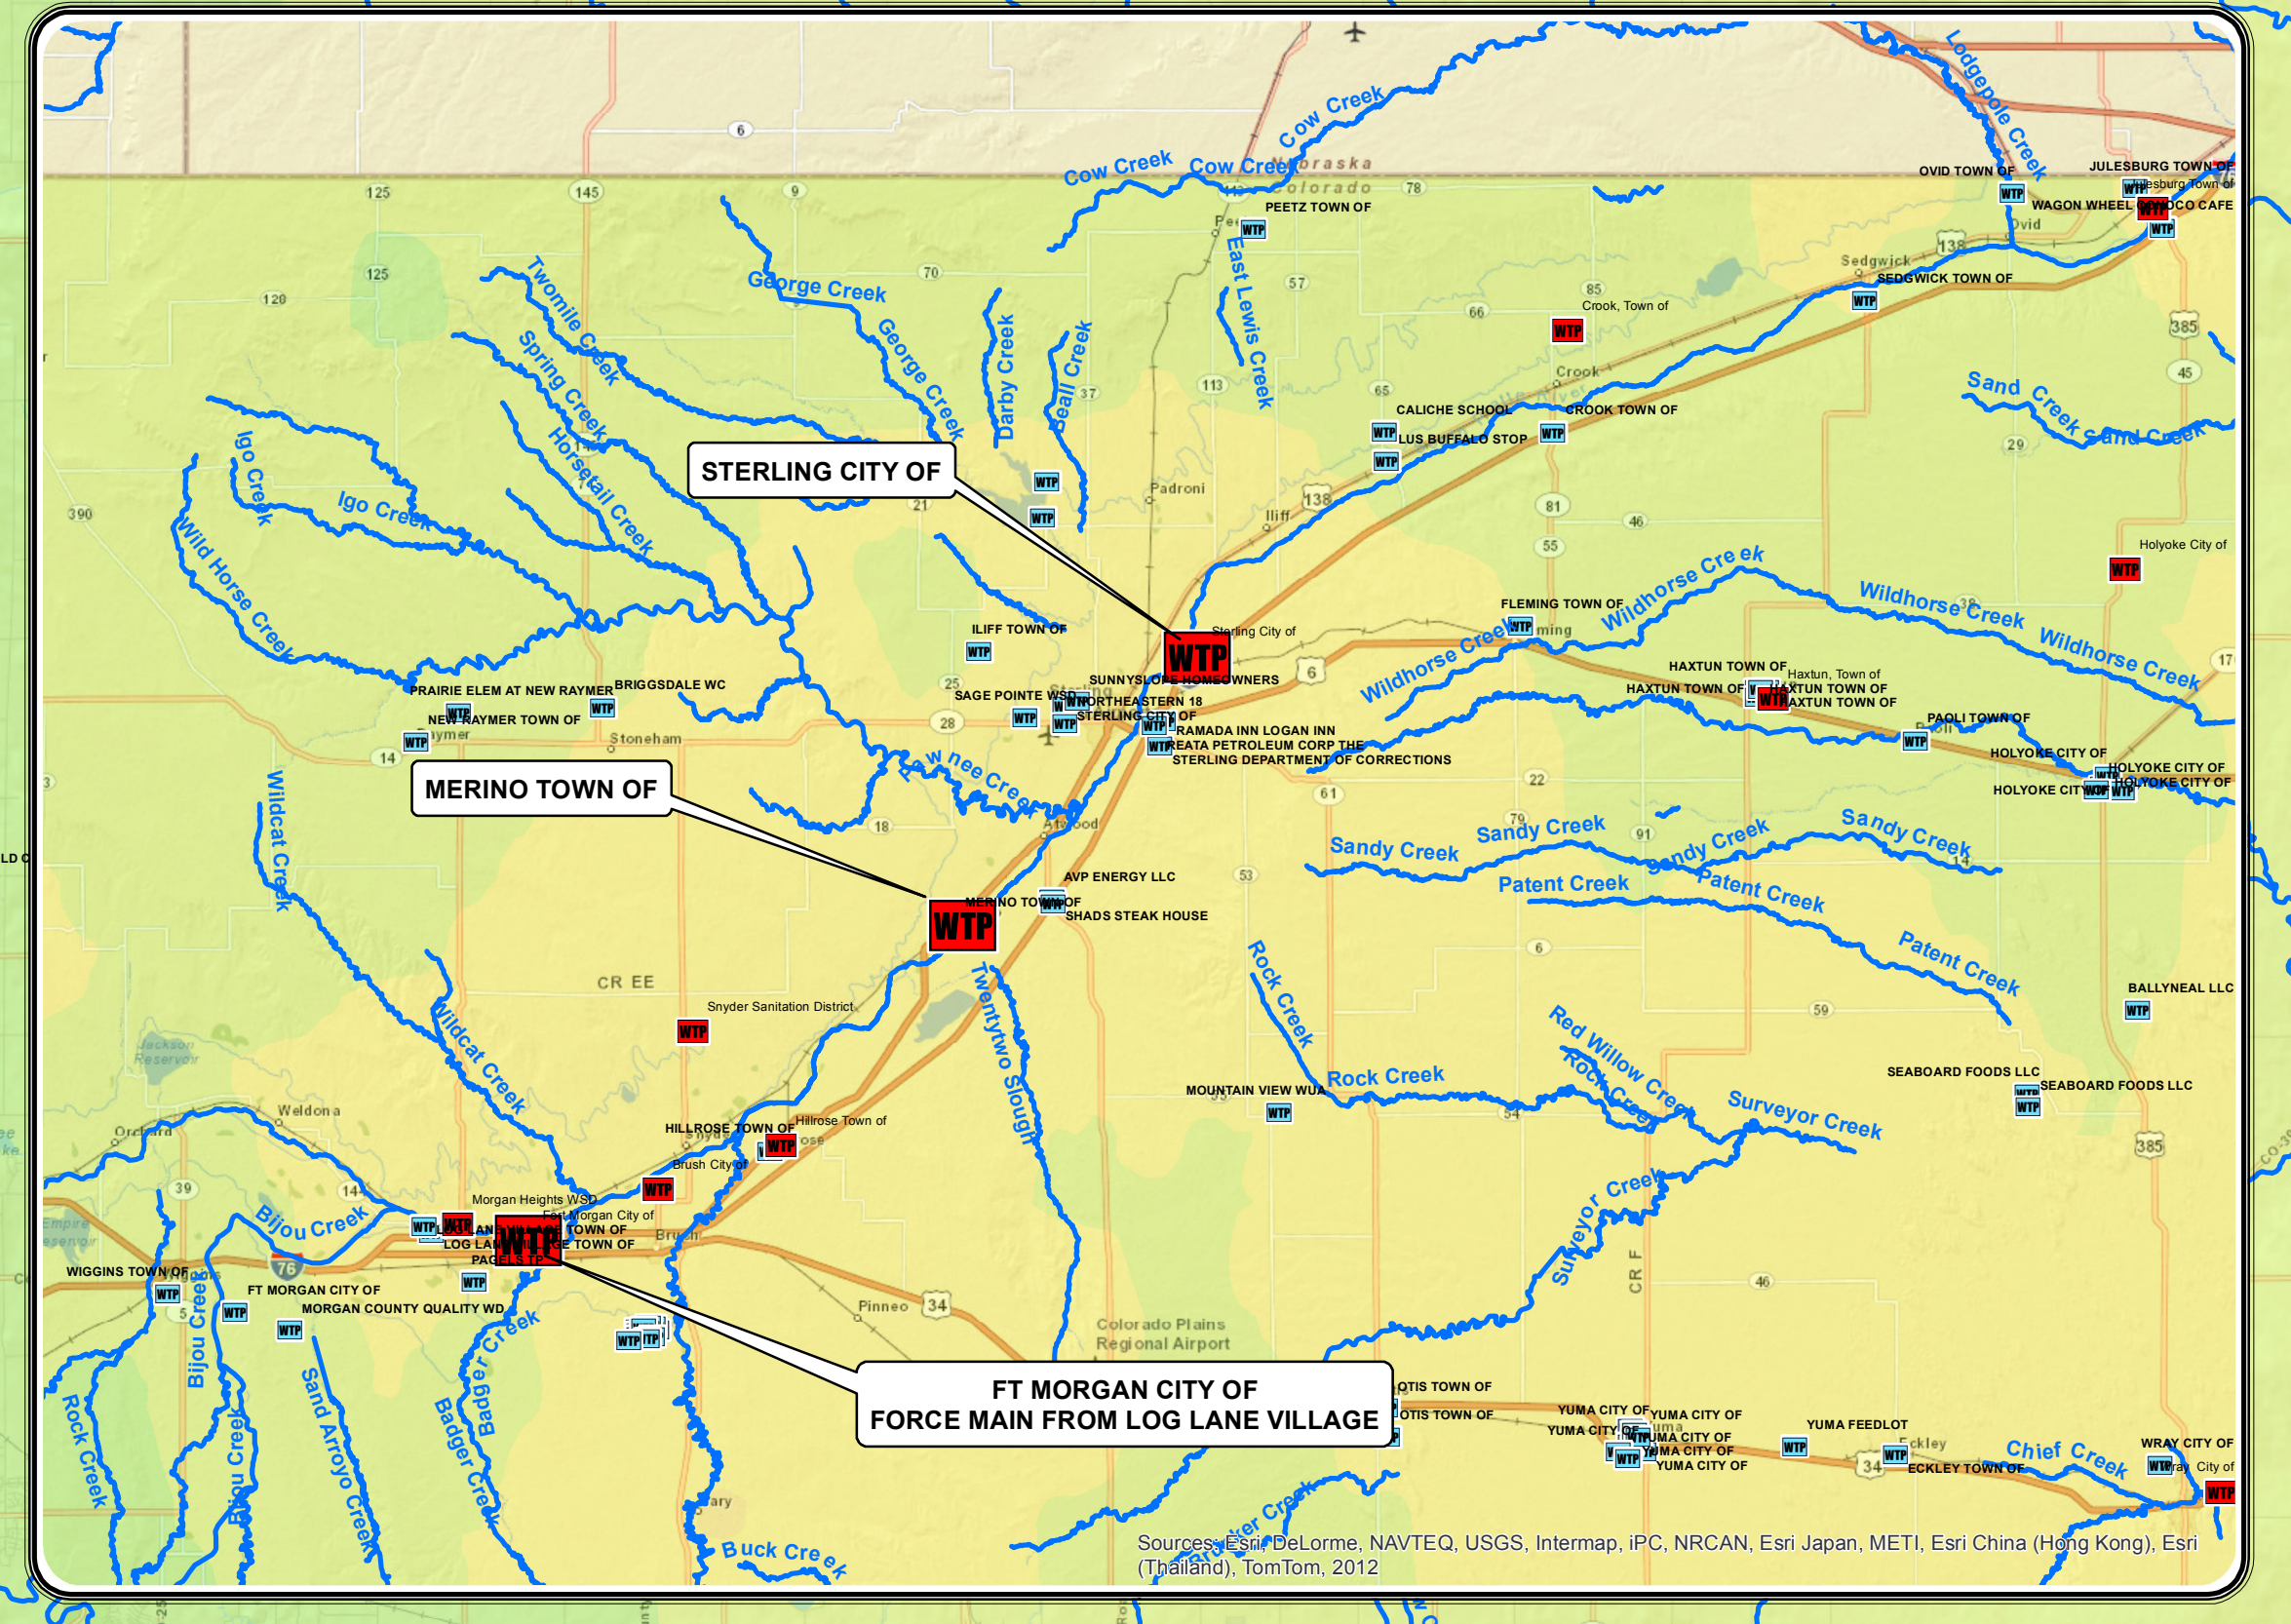

Eastern Plains

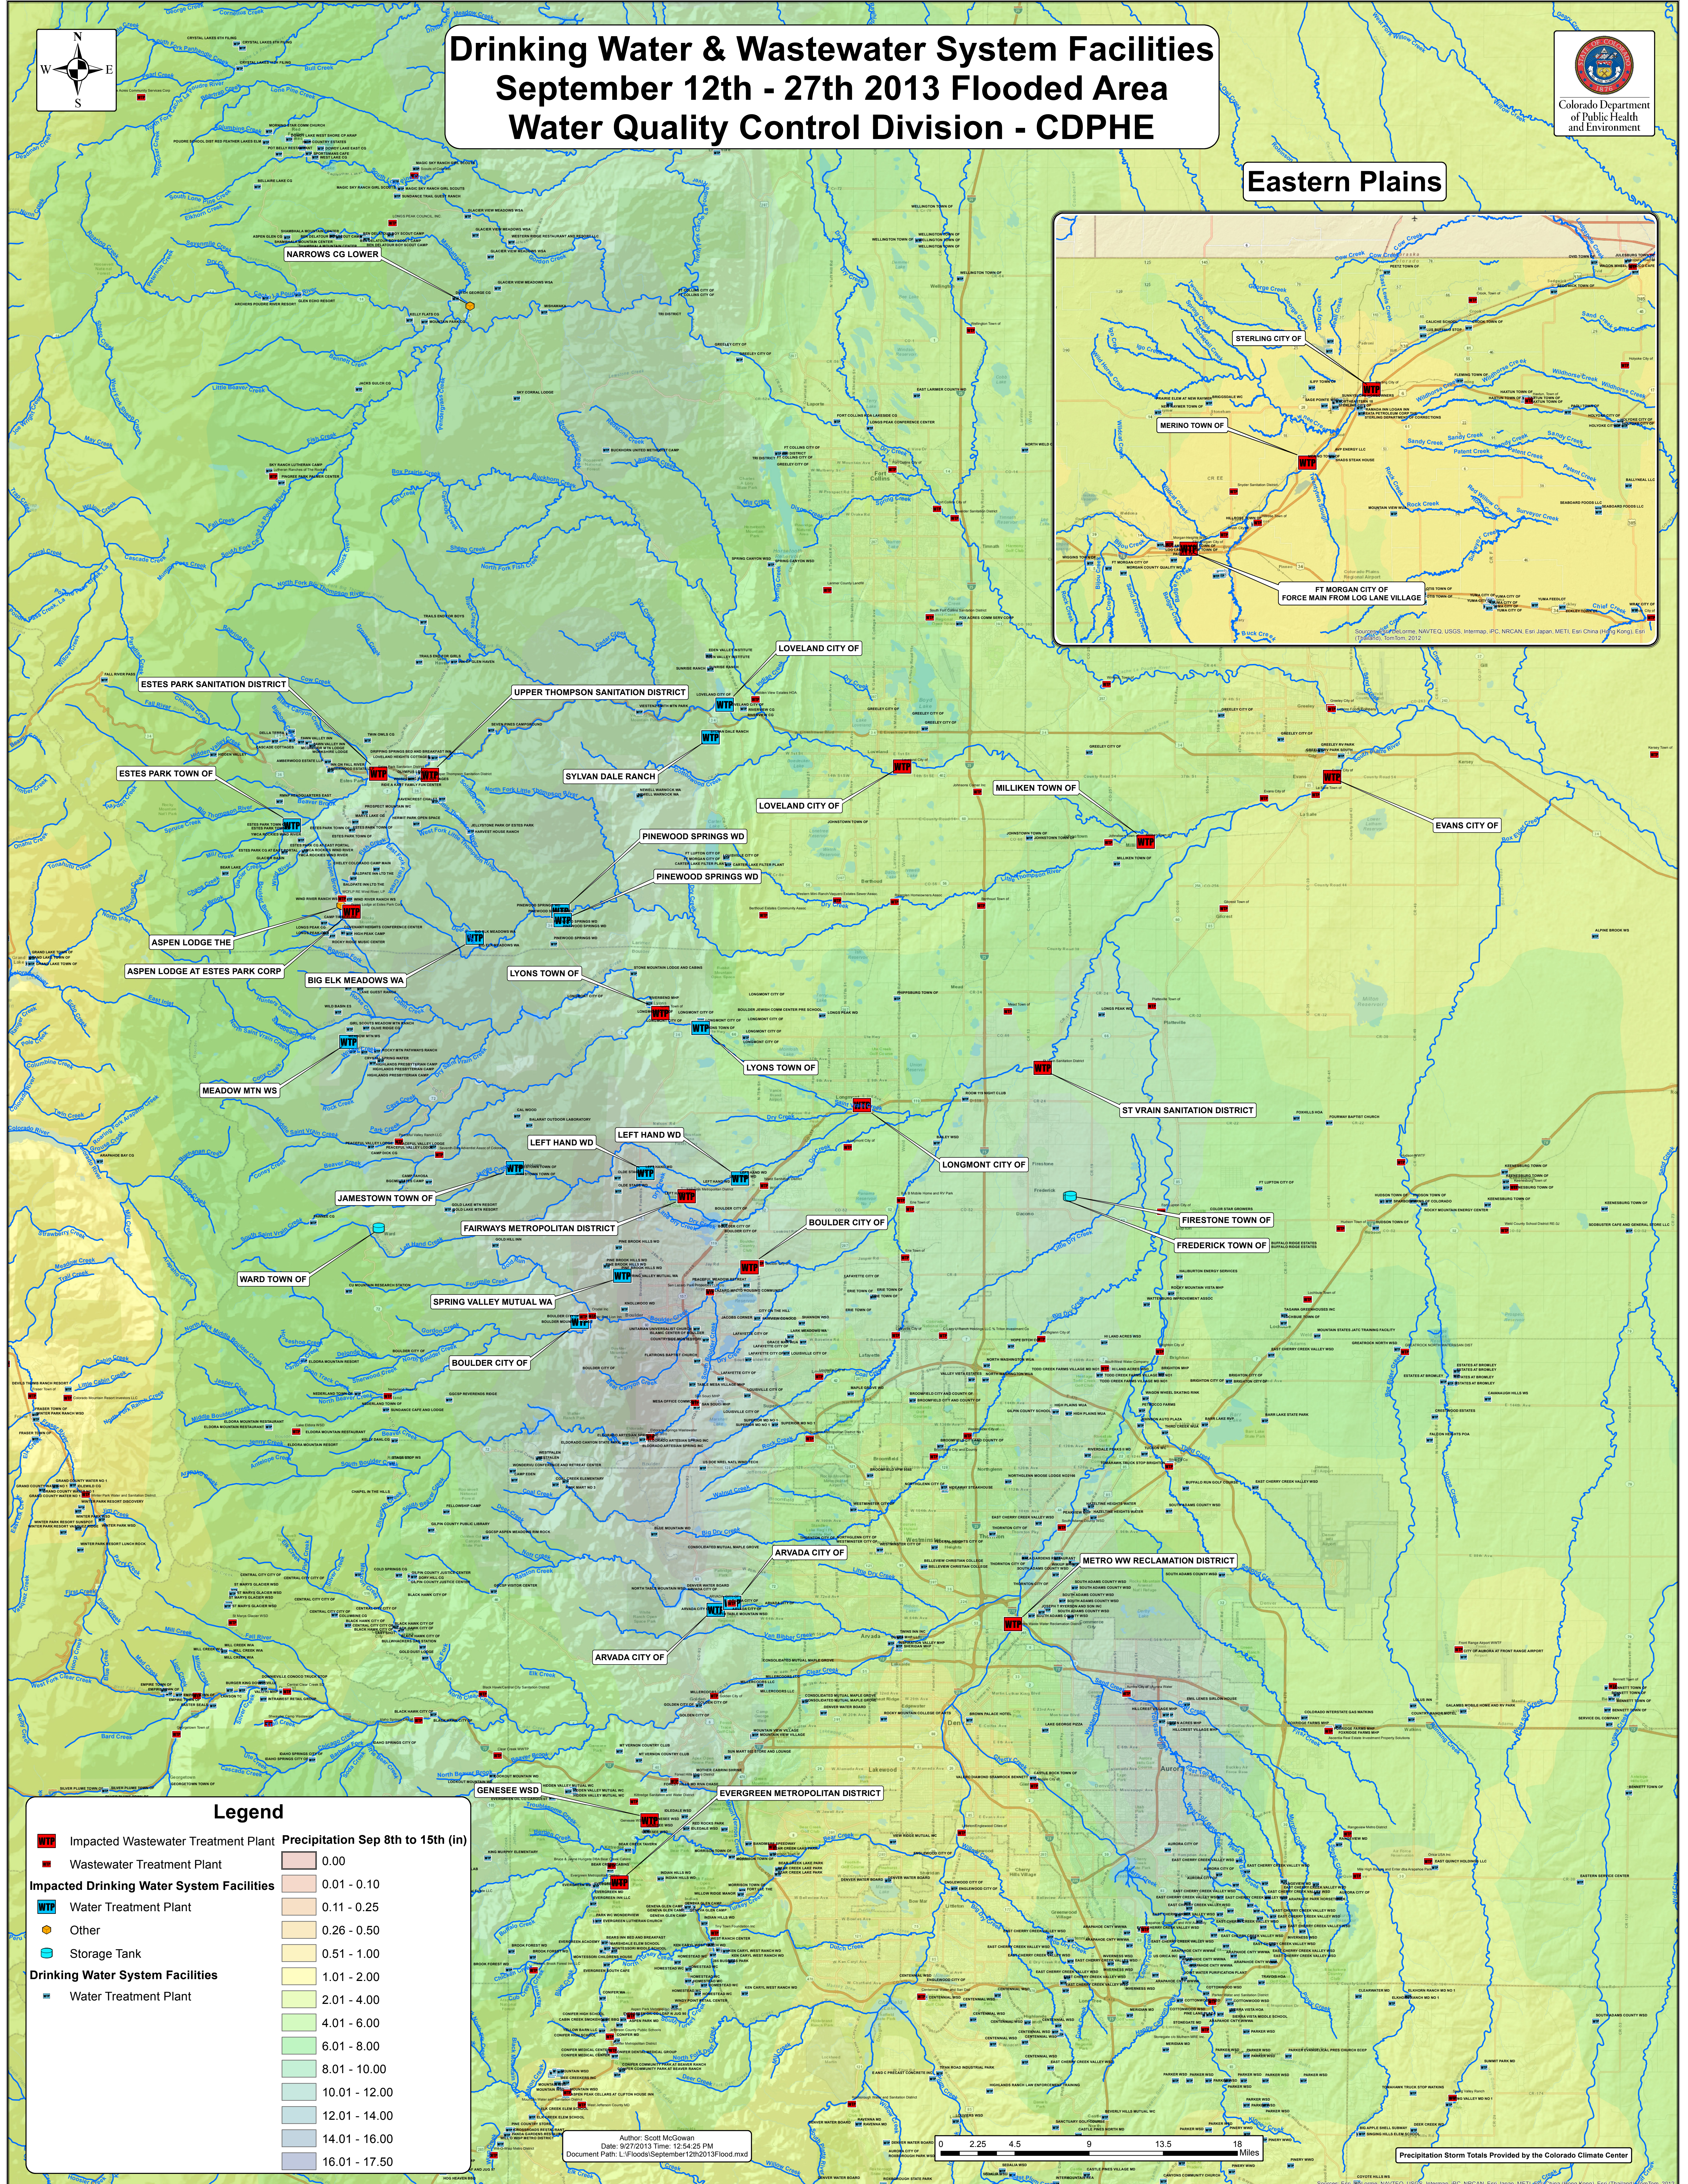


Legend

- Impacted Wastewater Treatment Plant
- Wastewater Treatment Plant
- Impacted Drinking Water System Facilities
- Water Treatment Plant
- Other
- Storage Tank
- Drinking Water System Facilities**
- Water Treatment Plant

Precipitation Sep 8th to 15th (in)
0.00
0.01 - 0.10
0.11 - 0.25
0.26 - 0.50
0.51 - 1.00
1.01 - 2.00
2.01 - 4.00
4.01 - 6.00
6.01 - 8.00
8.01 - 10.00
10.01 - 12.00
12.01 - 14.00
14.01 - 16.00
16.01 - 17.50

Author: Scott McGowan
Date: 9/27/2013 Time: 12:54:25 PM
Document Path: L:\Floods\September12th2013\Flood.mxd

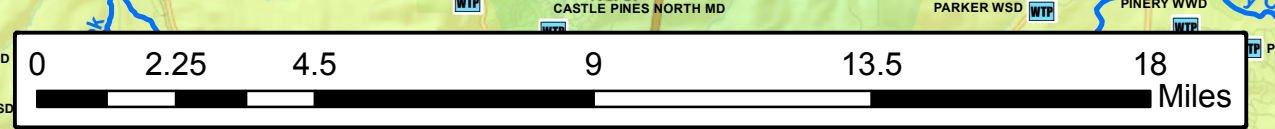

Precipitation Storm Totals Provided by the Colorado Climate Center

Source: Esri, DeLorme, NAVTEQ, USGS, Intermap, iPC, NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), Swisstopo